


FIRE HOSE CABINET 3/8" = 1'-0"
one required by plumbing & heating contr.

elkhart fire hose unit - 100 foot hose, 1 1/2" φ valve with elkhart fog nozzle as manufactured by elkhart manufacturing co. of elkhart, ind.

FIRST FLOOR PLAN 1/8" = 1'-0"

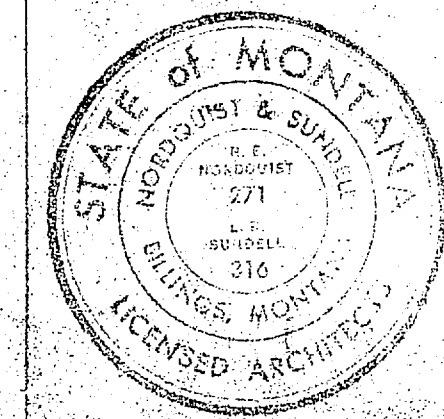

A STUDENT UNION BUILDING
EASTERN MONTANA COLLEGE OF EDUCATION
BILLINGS, MONTANA

NORQUIST & SURDELL
ARCHITECTS
BILLINGS, MONTANA

drawn	L.R.S.	A 2
checked	REN	
date	APR 5 1954	
job no.	1753	